



SECTION A-A

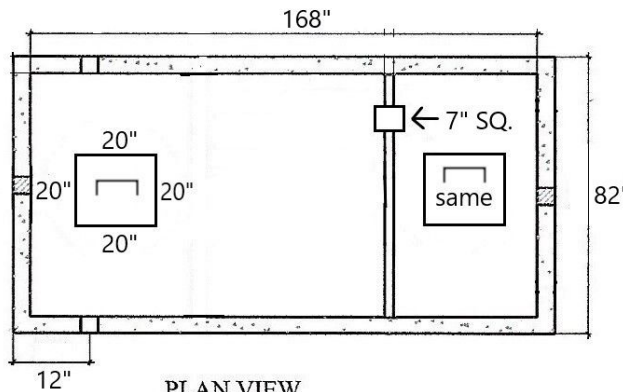


PLAN VIEW

NOTES:

1. CONCRETE STRENGTH = MIN. 4500 PSI
2. STRUCTURAL FIBER REINFORCEMENT
3. 4-5 INCH TAPERED WALLS
4. 5 INCH TOP AND BOTTOM
5. MASTIC SEALANT IN TANK JOINT
6. POLYLOK HANDLES IN LIDS
7. POLYLOK PIPE SEAL INLETS CAST-IN
8. 4" RUBBER BOOT OUTLET
9. MODIFICATIONS MADE UPON REQUEST

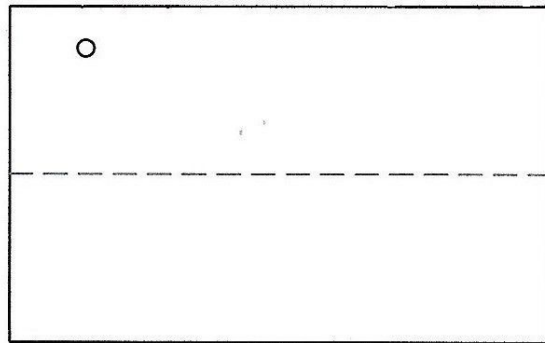

SIDE VIEW

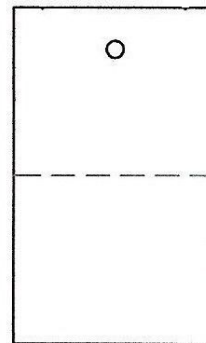

FRONT VIEW

Approx. Weight:
 Top= 12,340 lbs
 Bottom=12,440 lbs
 Total= 24,780 lbs

Gal. Per In = 49.5
 Actual Gal. To Outlet = 3,029
 Full Capacity = 3,616

LAKESIDE PRECAST

Abingdon, Virginia
 PH: 276-628-2472

2500 Gal. MS Tank 2 Comp

Date 07/12/2021
 RPAW

Scale
 Not To Scale

Sheet
 1